



Check One & attach a detailed plan to this

Water Line/Drain Line Plan
Exhibit "A-2" or "A-3"


NON-POTABLE WATER SOURCE (*Pumping from Lake*)

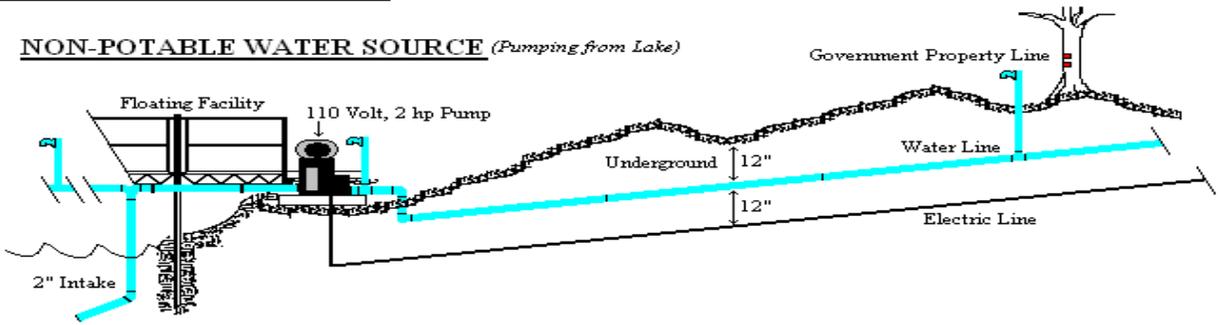

POTABLE WATER SOURCE (*From Private Water Source*)

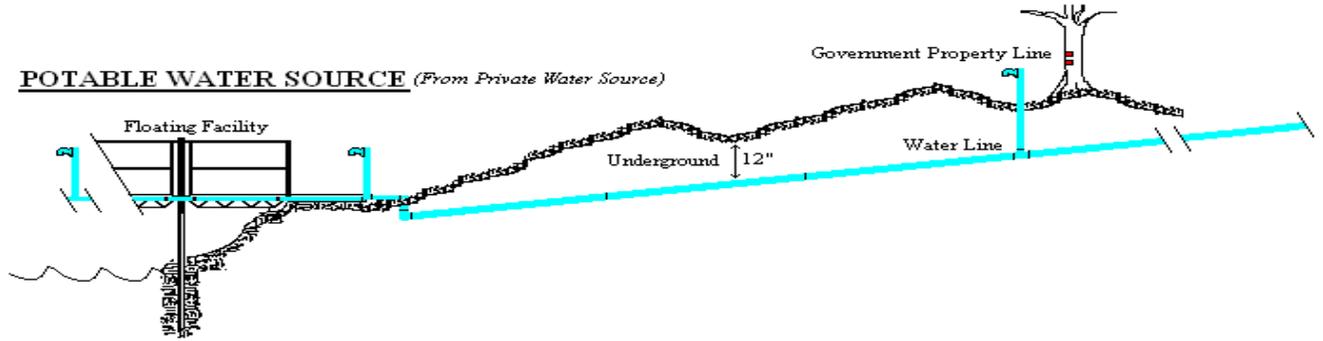

DRAIN LINE (Surface Run-off)

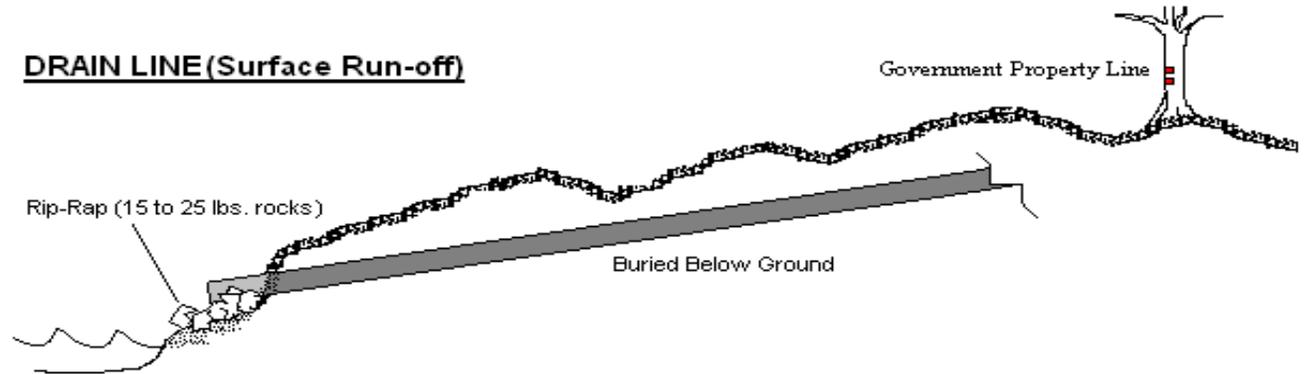

Regulations

1. All water lines must be installed underground and/or securely attached underneath a walkway.
2. Water lines on floating docks and boathouses must be securely attached to the walkway and dock.
3. Only one water faucet is permitted on a floating facility. Additional faucets on Government Property may be approved.
4. Restrooms, sinks, or fish cleaning stations are not permitted on Government Property or floating facilities.
5. Permanent sprinkler systems are not permitted on Government Property, the use of hoses with portable sprinklers is permitted.
6. The maximum size water pump permitted on is a 110 volt, 2 horsepower, with a maximum 2 inch intake line.
7. All wiring for the electric water pump must be installed in accordance with Corps of Engineers regulations.
8. No gasoline engine pumps are permitted.
9. If an electric line is buried in the same ditch with a water line, the water line must be 12 inches above the electric line and marked by buried tape above the water line.
10. Underground drainage pipes for handling surface run-off will be reviewed on a case by case basis. Open ditches are not permitted.

CONCEPTUALLY APPROVED
for

U.S. Army Corps of Engineers, Mobile District

BY: _____

DATE: _____

NOTICE: This approval stamp DOES NOT certify an engineering review. The builder should rely on professional engineering services to certify that the design is suitable for intended purposes and meets minimum standards including those related to the safety of the users.

I will construct this facility according to this plan.

Name: _____

Subdivision: _____

Lot No.: _____